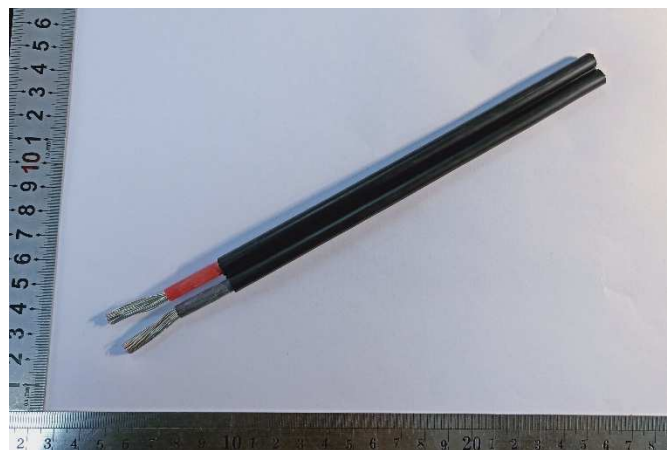


Prüfbericht-Nr.: Test report no.:	CN230O10 001	Auftrags-Nr.: Order no.:	244523293	Seite 1 von 23 Page 1 of 23
Kunden-Referenz-Nr.: Client reference no.:	N/A	Auftragsdatum: Order date:	14.06.2023	
Auftraggeber: Client:	SUNTREE Electric Group Co., Ltd. Xinguang Industrial Zone, Liushi Town, Yueqing City, Zhejiang, P.R. China			
Prüfgegenstand: Test item:	Electric Cables for Photovoltaic Systems			
Bezeichnung / Typ-Nr.: Identification / Type no.:	H1Z2Z2-K 1X2,5...240mm ² & 2X2,5...10mm ² (1949586-EN)			
Auftrags-Inhalt: Order content:	TÜV mark approval & LVD CoC			
Prüfgrundlage: Test specification:	EN 50618: 2014 Electric cables for photovoltaic systems with a voltage rating of 1,5 kV DC			
Wareneingangsdatum: Date of sample receipt:	20.09.2023			
Prüfmuster-Nr.: Test sample no.:	See Other below for details			
Prüfzeitraum: Testing period:	22.09.2023- 14.11.2023			
Ort der Prüfung: Place of testing:	See Other below for details			
Prüflaboratorium: Testing laboratory:	TÜV Rheinland (Shanghai) Co., Ltd.			
Prüfergebnis*: Test result*:	Pass			
geprüft von: tested by:	X 		genehmigt von: authorized by:	X 
Datum: Date:	2023.12.08		Ausstellungsdatum: Issue date:	2023.12.08
Stellung / Position:	Jingjing Wang/PE		Stellung / Position:	Tim Jing/Reviewer
Sonstiges / Other:	Place of testing: Place of testing: Hebei Academy of Product Quality Supervision & Inspection(HBPQ).: No. 103, XinXing Road, NingJin 055550, Hebei, China. Test sample no: GL202304094, GL202304095, GL202304097, GL202304098, GL202304100 and GL202304101 See more information on page 3.			
Zustand des Prüfgegenstandes bei Anlieferung: Condition of the test item at delivery:	Prüfmuster vollständig und unbeschädigt Test item complete and undamaged			
* Legende: P(ass) = entspricht o.g. Prüfgrundlage(n) F(ail) = entspricht nicht o.g. Prüfgrundlage(n) N/A = nicht anwendbar N/T = nicht getestet * Legend: P(ass) = passed a.m. test specification(s) F(ail) = failed a.m. test specification(s) N/A = not applicable N/T = not tested				
Dieser Prüfbericht bezieht sich nur auf das o.g. Prüfmuster und darf ohne Genehmigung der Prüfstelle nicht auszugsweise vervielfältigt werden. Dieser Bericht berechtigt nicht zur Verwendung eines Prüfzeichens. This test report only relates to the a. m. test sample. Without permission of the test center this test report is not permitted to be duplicated in extracts. This test report does not entitle to carry any test mark.				

V05

Test report no.: CN230O10 001
Prüfbericht-Nr.:

Page 2 of 23
Seite 2 von 23

Remarks
Anmerkungen

1	The equipment used during the specified testing period was calibrated according to our test laboratory calibration program. The equipment fulfils the requirements included in the relevant standards. The traceability of the test equipment used is ensured by compliance with the regulations of our management system. Detailed information regarding test conditions, equipment and measurement uncertainty is available in the test laboratory and could be provided on request. <i>Alle eingesetzten Prüfmittel waren zum angegebenen Prüfzeitraum gemäß eines festgelegten Kalibrierungsprogramms unseres Prüfhauses kalibriert. Sie entsprechen den in den Prüfprogrammen hinterlegten Anforderungen. Die Rückverfolgbarkeit der eingesetzten Prüfmittel ist durch die Einhaltung der Regelungen unseres Managementsystems gegeben. Detaillierte Informationen bezüglich Prüfbedingungen, Prüfequipment und Messunsicherheiten sind im Prüflabor vorhanden und können auf Wunsch bereitgestellt werden.</i>
2	As contractually agreed, this document has been signed digitally only. TÜV Rheinland has not verified and unable to verify which legal or other pertaining requirements are applicable for this document. Such verification is within the responsibility of the user of this document. Upon request by its client, TÜV Rheinland can confirm the validity of the digital signature by a separate document. Such request shall be addressed to our Sales department. An environmental fee for such additional service will be charged. <i>Wie vertraglich vereinbart, wurde dieses Dokument nur digital unterzeichnet. Der TÜV Rheinland hat nicht überprüft, welche rechtlichen oder sonstigen diesbezüglichen Anforderungen für dieses Dokument gelten. Diese Überprüfung liegt in der Verantwortung des Benutzers dieses Dokuments. Auf Verlangen des Kunden kann der TÜV Rheinland die Gültigkeit der digitalen Signatur durch ein gesondertes Dokument bestätigen. Diese Anfrage ist an unseren Vertrieb zu richten. Eine Umweltgebühr für einen solchen zusätzlichen Service wird erhoben.</i>
3	Test clauses with remark of * are subcontracted to qualified subcontractors and described under the respective test clause in the report. Deviations of testing specification(s) or customer requirements are listed in specific test clause in the report. <i>Prüfklausel mit der Note * wurden an qualifizierte Unterauftragnehmer vergeben und sind unter der jeweiligen Prüfklausel des Berichts beschrieben. Abweichungen von Prüfspezifikation(en) oder Kundenanforderungen sind in der jeweiligen Prüfklausel im Bericht aufgeführt.</i>
4	The decision rule for statements of conformity, based on numerical measurement results, in this test report is based on the "Zero Guard Band Rule" and "Simple Acceptance" in accordance with ILAC G8:2019 and IEC Guide 115:2021, unless otherwise specified in the applied standard mentioned on Page 1 of this report or requested by the customer. This means that measurement uncertainty is not taken in account and hence also not declared in the test report. For additional information to the resulting risk based of this decision rule please refer to ILAC G8:2019. <i>Die Entscheidungsregel für Konformitätserklärungen basierend auf numerischen Messergebnissen in diesem Prüfbericht basiert auf der "Null-Grenzwert-Regel" und der "Einfachen Akzeptanz" gemäß ILAC G8:2019 und IEC Guide 115:2021, es sei denn, in der auf Seite 1 dieses Berichts genannten angewandten Norm ist etwas anderes festgelegt oder vom Kunden gewünscht. Dies bedeutet, dass die Messunsicherheit nicht berücksichtigt wird und daher auch nicht im Prüfbericht angegeben wird. Zu weiteren Informationen bezüglich des Risikos durch diese Entscheidungsregel siehe ILAC G8:2019.</i>
5	

Prüfbericht-Nr.: CN230O10 001
Test Report No.:

Seite 3 von 23
Page 3 of 23

Produktbeschreibung
Product description

Characteristics of cable						
Code designation		H1Z2Z2-K				
Trademark		SUNTREE Electric Group Co., Ltd.				
Rated Voltage AC		U ₀ /U AC: 1/1 kV				
Rated voltage DC		1,5 kV DC (conductor-conductor and conductor-earth)				
Cross section:	[mm ²]	1X240	2X2,5(R)	2X2,5(B)	2X10(R)	2X10(B)
Outer dimension:	[mm]	29,3	5,6	5,6	8,0	7,8
Meas. wall thickness insulation:	[mm]	1,7	0,9	0,9	0,8	0,9
Min. wall thickness insulation:	[mm]	1,7	0,7	0,7	0,7	0,7
Meas. wall thickness sheath:	[mm]	2,0	0,9	0,9	1,2	1,0
Min. wall thickness sheath:	[mm]	1,7	0,8	0,8	0,8	0,8
Min. wall thickness compl. Insulation:	[mm]	3,52	1,57	1,54	1,48	1,57
Standard		EN 50618: 2014				
Lower ambient temperature		-40 °C				
Upper ambient temperature		+90 °C				
Max temperature at conductor		+120°C @ 20.000 h (see enclosed Arrhenius curve)				
Material separation layer between conductor and insulation		—				
Material insulation		XLPO				
Material separation layer between insulation and sheath		—				
Material sheath		XLPO				
Extrusion type		Tandem Extrusion				

Remarks:

This report is created for H1Z2Z2-K 1X2,5...240mm² & 2X2,5...10mm².

All type tests except test of ref. No. 1.4 in Table B.1 according to EN 50618: 2014 in this report were performed to the complete cable H1Z2Z2-K 1X240mm² with 100m, H1Z2Z2-K 2X2,5mm² with 100m and 2X10mm² with 30m.

Tests of ref. No. 1.4 in Table B.1 according to EN 50618: 2014 in this report refer to test report 50289453 001 for detail.

The two-core cables of H1Z2Z2-K 2X2,5...10mm² have two parallel cores, which are connected depending on the outer surface of the sheath. For the colors of insulations in the two cores, one is black and another one is red. The color of sheath is black. "R" is for red core, and "B" is for black core of two-core cables of H1Z2Z2-K 2X2,5...10mm².

This test report contains 23 pages and an attachment 1 with 6 pages for testing equipment list.

Prüfbericht-Nr.: CN230O10 001			Seite 4 von 23	
<i>Test Report No.:</i>			Page 4 of 23	
Absatz	EN 50618:2014	Messergebnisse - Bemerkungen	Bewertung	
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation	
5.1	CONDUCTOR			
5.1.1	Material			
	Number of cores:	1 or 2	P	☒
			F	☐
			N/A	☐
			N/T	☐
	Single wires are of copper and tinned:	tinned copper wire	P	☒
			F	☐
			N/A	☐
			N/T	☐
	Compliance with class 5 acc. to IEC 60228 <i>SEE TABLE 5.1.5</i>	class 5 conductors	P	☒
			F	☐
			N/A	☐
			N/T	☐
	There are no visible gaps in the continuous layer, when examined with normal or corrected vision.	no visible gaps	P	☒
			F	☐
			N/A	☐
			N/T	☐
5.1.2	CONSTRUCTION			
	The class of the conductor must be class 5 in accordance to EN 60228		P	☒
			F	☐
			N/A	☐
			N/T	☐
	The maximum diameter of the wires in the conductor are be in accordance to EN 60228		P	☒
			F	☐
			N/A	☐
			N/T	☐
5.1.3	SEPERATOR BETWEEN CONDUCTOR AND INSULATION			
	Separation layer of halogen free material between insulation and conductor		P	☐
			F	☐
			N/A	☒
			N/T	☐
5.1.4	CHECK OF CONSTRUCTION			
	The construction must be checked in accordance of the requirements of 5.1.1, 5.1.2 and 5.1.3 including the requirements of EN 60228 for class 5 conductor	checked		
5.1.5	ELECTRICAL RESISTANCE			

Prüfbericht-Nr.: CN230O10 001 Test Report No.:			
Absatz	EN 50618:2014	Messergebnisse - Bemerkungen	Bewertung
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation
	The resistor of each conductor at 20°C must be in accordance with the requirements of EN 60228 for class 5 conductor		P ☒ F ☐ N/A ☐ N/T ☐
	Compliance must be checked by the test of clause 5 of EN 50395		P ☒ F ☐ N/A ☐ N/T ☐
5.2	INSULATION		
5.2.1	MATERIAL		
	The insulation must be crosslinked and fulfil the requirements of table B.1 in Annex B	XLPO in black or red	P ☒ F ☐ N/A ☐ N/T ☐
5.2.2	APPLICATION TO THE CONDUCTOR		
	Insulation extruded, smooth and consistently applied and possible to remove without damage to the insulation itself, to the conductor or to the tin coating.		P ☒ F ☐ N/A ☐ N/T ☐
	Compliance must be checked by inspection and by manual test		P ☒ F ☐ N/A ☐ N/T ☐
5.2.3	THICKNESS		
	For each piece of insulation, the average of the measured values, rounded to 0,1 mm have be not less than the specified value for each size of table 1		P ☒ F ☐ N/A ☐ N/T ☐
	The smallest value must not fall below 90% of the specified value by more than 0,1 mm. Compliance must be checked using by test of clause 4.1 of EN 50396		P ☒ F ☐ N/A ☐ N/T ☐
5.3	SHEATH		
	The sheath must be crosslinked and fulfil the requirements of table B.1 in Annex B	XLPO in black	P ☒ F ☐ N/A ☐ N/T ☐

Prüfbericht-Nr.: CN230O10 001				
Test Report No.:				
Absatz	EN 50618:2014	Messergebnisse - Bemerkungen	Bewertung	
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation	
5.3.2	APPLICATION			
	The sheath must be applied homogeneously by extrusion and halogen free material. The application of the sheath must give the finished cable a practically circular shape		P ☒ F ☐ N/A ☐ N/T ☐	
	Separation layer of halogen free material between insulation and sheath		P ☐ F ☐ N/A ☒ N/T ☐	
5.3.3	THICKNESS			
	For each piece of insulation, the average of the measured values, rounded to 0,1 mm must be less than the specified value for each size of table 1		P ☒ F ☐ N/A ☐ N/T ☐	
	The smallest value must not fall below 85% of the specified value by more than 0,1 mm. Compliance must be checked using by test of clause 4.1 of EN 50396		P ☒ F ☐ N/A ☐ N/T ☐	
5.3.4	COLOUR			
	The colour of the sheath must be black, unless otherwise agreed between manufacturer and customer. The colour must be throughout for whole sheath.	black sheath	P ☒ F ☐ N/A ☐ N/T ☐	
6	MARKING			
6.1	GENERAL			
	The marking at the sheath must be by printing, embossing or indenting.	by printing	P ☒ F ☐ N/A ☐ N/T ☐	
6.2	INDICATION OF ORIGIN			
	Cables are marked with			
	a) manufacturer's name or Trademark or identification number	SUNTREE Electric Group Co., Ltd.	P ☒ F ☐ N/A ☐ N/T ☐	

Prüfbericht-Nr.: CN230O10 001
Test Report No.:

Seite 7 von 23
Page 7 of 23

Absatz Clause	EN 50618:2014 Anforderungen - Prüfungen / Requirements - Tests	Messergebnisse - Bemerkungen Measuring results - Remarks	Bewertung Evaluation
6.3	b) Code designation	H1Z2Z2-K	P ☒ F ☐ N/A ☐ N/T ☐
6.4	c) Nominal cross-sectional area of conductor	1X2,5...240mm ² 2X2,5...10mm ²	P ☒ F ☐ N/A ☐ N/T ☐
6.5	CONTINUITY OF MARKING		
	Spacing between the end of marking and the begin of the following identical marking does not exceed 550mm	=<550mm	P ☒ F ☐ N/A ☐ N/T ☐
6.6	The name CENELEC, in full or abbreviated, does not be marked on, or in, the cables		P ☐ F ☐ N/A ☒ N/T ☐
6.7.1	Marking is still legible after test of cl. 5.1 of EN 50396		P ☒ F ☐ N/A ☐ N/T ☐
6.7.2	All markings are legible.		P ☒ F ☐ N/A ☐ N/T ☐
Table 2	TEST FOR CABLES TO EN 50618		
1	ELECTRICAL TEST		
1.1.1	Conductor resistance SEE CLAUSE 5.1.5 AND TABLE 5.1.5		P ☒ F ☐ N/A ☐ N/T ☐
1.2	No breakdown at high voltage test with		
	- AC 6,5kV, or		P ☒ F ☐ N/A ☐ N/T ☐
	- DC 15kV		P ☐ F ☐ N/A ☒ N/T ☐

Prüfbericht-Nr.: CN230O10 001 Test Report No.:			
Absatz	EN 50618:2014	Messergebnisse - Bemerkungen	Bewertung
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation
1.4	Insulation resistance		
1.4.1.2	- during test in water at 20°C Min. as stated in table 1 of this standard: see table 8.1		P ☒ F ☐ N/A ☐ N/T ☐
1.4.2	- during test in water at 90°C Min. as stated in table 1 of this standard: see table 8.1		P ☒ F ☐ N/A ☐ N/T ☐
1.5.1	During long term resistance of insulation to D.C. a stable progress has been identified, no breakdown of the test voltage: [V d.c.]	1,8 kV, no breakdown	P ☒ F ☐ N/A ☐ N/T ☐
1.5.2	After long term resistance test no damage or cracks of the insulation have been visible.	no damage and visible cracks	P ☒ F ☐ N/A ☐ N/T ☐
1.6.2	Surface resistance of sheath min 10 GOhm: [Ohm]	1X240mm2: 3000GOhm 2X2,5mm2(R):430GOhm 2X2,5mm2(B):520GOhm	P ☒ F ☐ N/A ☐ N/T ☐
2	CONSTRUCTIONAL AND DIMENSIONAL TEST		
2.1	Conductor		P ☒ F ☐ N/A ☐ N/T ☐
2.1.1	Maximum diameter of the conductor in accordance to EN 60228 clause 6.1 SEE table 5.1.5		P ☒ F ☐ N/A ☐ N/T ☐
2.1.2	Checking continuity of tin to clause 5.1.1 No visible gaps occurred	no visible gaps	P ☒ F ☐ N/A ☐ N/T ☐
2.2	Wall thickness of insulation Not less than stated in clause 5.2.3 of this standard SEE TABLE 5.2.3		P ☒ F ☐ N/A ☐ N/T ☐
2.3	Wall thickness of sheath Not less than stated in clause 5.3.3 of this standard SEE TABLE 5.3.3		P ☒ F ☐ N/A ☐ N/T ☐
	Measurement of overall dimensions Not less than stated in table 1 of this standard SEE TABLE 5.3.4		P ☒ F ☐ N/A ☐ N/T ☐

Prüfbericht-Nr.: CN230O10 001			Seite 9 von 23	
Test Report No.:			Page 9 of 23	
Absatz	EN 50618:2014	Messergebnisse - Bemerkungen	Bewertung	
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation	
	Mean value <i>SEE TABLE 7.3.3</i>		P	☒
			F	☐
			N/A	☐
			N/T	☐
2.4	Ovality max. 15% Not less than stated in clause 7.3.3 of this standard <i>SEE TABLE 7.3.3</i>		P	☒
			F	☐
			N/A	☐
			N/T	☐
2.5 2.5.1	Sheath colour Visual examination as stated in clause 7.3.1 of this standard	black	P	☒
			F	☐
			N/A	☐
			N/T	☐
2.6 2.6.1	Sheath marking Visual examination and measurement as stated in clause 7.3.2 of this standard		P	☒
			F	☐
			N/A	☐
			N/T	☐
3	Insulation material as stated in table B.1 of this standard		P	☒
			F	☐
			N/A	☐
			N/T	☐
4	Sheath material as stated in table B.1 of this standard		P	☒
			F	☐
			N/A	☐
			N/T	☐
5	COMPATIBILITY TEST ACCORDING TO EN 60811-401			
5.1	Test conditions: Duration of test 168 h Temperature 135 ± 2 °C			
5.2	Result in accordance to Table B.1 Lfd. No.: 1.7 of this standard <i>SEE RESULT OF TABLE B1 No. 1.7</i>		P	☒
			F	☐
			N/A	☐
			N/T	☐
6	COLD IMPACT TEST ACCORDING TO EN 60811-506			
6.1	Test conditions as stated in annex C of this standard -40°C	-40° C, 16h mass of hammer: 1000g height: 100mm		
6.2	After the test no cracks are visible	no visible cracks	P	☒
			F	☐
			N/A	☐
			N/T	☐
7	COLD BENDING TEST ACCORDING TO EN 60811-504 (Cable diameter ≤ 12,5 mm)			

Prüfbericht-Nr.: CN230O10 001 Test Report No.:			
Absatz	EN 50618:2014	Messergebnisse - Bemerkungen	Bewertung
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation
7.1	Test conditions: Conditioning duration 16 h: Temperature $-40 \pm 2^{\circ}\text{C}$: Diameter of mandrel: [mm]	-40°C, 16h	
7.2	After the test no cracks are visible	no visible cracks	P ☒ F ☐ N/A ☐ N/T ☐
8	COLD ELONGATION TEST ACCORDING TO EN 60811-505 (Cable diameter > 12,5 mm)		
8.1	Test conditions: Conditioning duration 16 h Temperature $-40 \pm 2^{\circ}\text{C}$		
	Elongation at break min 30%: [%]	1X240mm2: 51%	P ☒ F ☐ N/A ☐ N/T ☐
9	OZONE RESISTANCE ON COMPLETE CABLE		
9.1	Method A: Temperature $25 \pm 2^{\circ}\text{C}$ Duration 24 h Ozone concentration (by volume) $(250-300) \cdot 10^{-4} \%$		P ☐ F ☐ N/A ☒ N/T ☐
9.2	Method B: Temperature $40 \pm 2^{\circ}\text{C}$ Relative humidity $55 \pm 5 \%$ Duration 72 h Ozone concentration (by volume) $(150-250) \cdot 10^{-6} \%$	1X240mm2: 2X2,5mm2:	P ☒ F ☐ N/A ☐ N/T ☐
9.3	After the test no cracks are visible	no visible cracks	P ☒ F ☐ N/A ☐ N/T ☐
10	WEATHERING / UV RESISTANCE TEST (see annex E)		
10.1	Temperature during drying $65 \pm 3^{\circ}\text{C}$ Relative humidity 65 % Power at wavelength betw. 300 to 400 nm $60 \pm 2 \text{ W/m}^2$ Duration spraying/ drying 18 / 102 Min Duration 720 h After test conditioning the exposed five specimens at ambient temperature for 16h	1X240mm2: 2X2,5mm2	P ☒ F ☐ N/A ☐ N/T ☐

Prüfbericht-Nr.: CN230O10 001
Test Report No.:

Seite 11 von 23
Page 11 of 23

Absatz	EN 50618:2014	Messergebnisse - Bemerkungen	Bewertung
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation
10.2	Variation of tensile strength $\geq 70\%$ Variation of elongation at break $\geq 70\%$ <i>SEE TABLE B.1</i>		P ☒ F ☐ N/A ☐ N/T ☐
11	DYNAMIC PENETRATION TEST (annex D) <i>see table 7.4</i>		P ☒ F ☐ N/A ☐ N/T ☐
12	DAMP HEAT TEST		
12.1	Temperature 90 °C Duration 1000 h Relative humidity min. 85 % Reconditioning period 16 to 24 h		
12.2	Variation of tensile strength max. - 30% <i>SEE TABLE B.1</i>		P ☒ F ☐ N/A ☐ N/T ☐
	Variation of elongation at break max. - 30% <i>SEE TABLE B.1</i>		P ☒ F ☐ N/A ☐ N/T ☐
13	SHRINKAGE		
13.1	Length of cable before test [mm] Length of cable after test: [mm]		
13.2	Shrinkage after test max 2%: [%]	1X240mm2: 1% 2X2,5: 1%	P ☒ F ☐ N/A ☐ N/T ☐
14	TEST UNDER FIRE CONDITIONS		
14.1	Length of sample 600 $\pm$ 25 mm Temperature during conditioning 23 $\pm$ 5 °C Relative humidity during conditioning 50 $\pm$ 20 % Duration of conditioning 16 h Overall diameter of test sample: [mm] Duration of flame application, depending on the diameter of the test sample 60 s	overall diameter: 1X240mm2: 29,4mm 2X2,5(R): 5,6mm 2X2,5(B): 5,6mm 2X10(R) : 8,0mm 2X10(B) : 7,8mm	
	Distance from the lower edge of the top support to the upper onset of charring > 50 mm: [mm]	1X240mm2: 383 2X2,5(R/B/ R+B): 388/387/378 2X10(R/B/ R+B): 373/376/375	P ☒ F ☐ N/A ☐ N/T ☐

Prüfbericht-Nr.: CN230O10 001 Test Report No.:			
Absatz	EN 50618:2014	Messergebnisse - Bemerkungen	Bewertung
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation
	Charring does not extend downwards to a point greater than 540 mm from the lower edge of the top support: [mm]	1X240mm2: 502 2X2,5(R/B/ R+B): 495/496/497 2X10(R/B/R+B):504/499/501	P ☒ F ☐ N/A ☐ N/T ☐
15	SMOKE EMISSION OF COMPLETE CABLE ACCORDING TO EN 61034-2		
15.1	Test result light transmittance, min 60%: [%]	1X240mm2: 82 2X2,5(R/B/ R+B): 83/83/75 2X10(R/B/R+B): 70/72/78	P ☒ F ☐ N/A ☐ N/T ☐
16	ASSESSMENT OF HALOGEN ACCORDING TO 50525-1 ANNEX B		
16.1	Determination of halogen		P ☒ F ☐ N/A ☐ N/T ☐
	Chloride, fluoride and bromide have been determined during test acc. to annex C (If yes, continue with phase 1)		P ☒ F ☐ N/A ☐ N/T ☐
	Phase 1		
	ph-value min. 4,3: [ph]	1X240mm2: insulation/sheath: 5,8/5,9 2X2,5insulation(R/B):5,8/5,8 sheath(R/B):5,9/5,9	P ☒ F ☐ N/A ☐ N/T ☐
	If ph-value min. 4,3 conductivity must be measured: [µS/mm]	1X240mm2: insulation/sheath: 1/1 2X2,5insulation(R/B): 1/1 sheath(R/B): 1/1	P ☒ F ☐ N/A ☐ N/T ☐
	If conductivity is > 2,5 µS/mm but < 10 µS/mm continue with phase 2, if conductivity is max. 2,5 µS/mm material is acceptable without phase 2		P ☐ F ☐ N/A ☒ N/T ☐
	Phase 2		
	Chlorine- and bromine content max. 0,5% (continue with phase 3): [%]	1X240mm2: <0,5 for both insulation and sheath 2X2,5mm2: <0,5 for all insulation and sheath	P ☒ F ☐ N/A ☐ N/T ☐
	Phase 3		

Prüfbericht-Nr.: CN230O10 001
Test Report No.:

Seite 13 von 23
Page 13 of 23

Absatz	EN 50618:2014	Messergebnisse - Bemerkungen	Bewertung
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation
	Flouride content max. 0,5%: [%]	1X240mm2: 0,03 for both insulation and sheath 2X2,5mm2: 0,03 for all insulation and sheath	P ☒ F ☐ N/A ☐ N/T ☐
Table B.1	REQUIREMENTS FOR INSULATION AND SHEATHING MATERIALS		
1	MECHANICAL CHARACTERISTICS		
1.1	Mechanical properties before ageing		
1.1.1	Determined median values for tensile strengt		
	- for insulation min. 8,0N/mm ² SEE TABLE B.1		P ☒ F ☐ N/A ☐ N/T ☐
	- for sheath min. 8,0N/mm ² SEE TABLE B.1		P ☒ F ☐ N/A ☐ N/T ☐
1.1.2	Determined median values for elongation at break		
	- for insulation min. 125% SEE TABLE B.1		P ☒ F ☐ N/A ☐ N/T ☐
	- for sheath min 125% SEE TABLE B.1		P ☒ F ☐ N/A ☐ N/T ☐
1.2	MECHANICAL PROPERTIES AFTER AGEING IN OVEN (150°C/168H)		
1.2.1	Test temperature: 150 ± 2°C Test duration: 168h		
1.2.2	Determined median values for tensile strength		
	- for insulation variation max. - 30% SEE TABLE B.1		P ☒ F ☐ N/A ☐ N/T ☐

Prüfbericht-Nr.: CN230010 001
Test Report No.:

Seite 14 von 23
Page 14 of 23

Absatz Clause	EN 50618:2014 Anforderungen - Prüfungen / Requirements - Tests	Messergebnisse - Bemerkungen Measuring results - Remarks	Bewertung Evaluation
	- for sheath variation max. - 30% SEE TABLE B.1		P ☒ F ☐ N/A ☐ N/T ☐
1.2.3	Determined median values for elongation at break		
1.2.3	- for insulation variation max. - 30% SEE TABLE B.1		P ☒ F ☐ N/A ☐ N/T ☐
	- for sheath variation max. - 30% SEE TABLE B.1		P ☒ F ☐ N/A ☐ N/T ☐
1.3	HOT SET TEST IN OVEN ACCORDING TO EN 60811-507 (250°C / 15 MIN / 20N/cm2)		
1.3.2	Elongation under load max. 100%: [%]	1X240mm2: insulation/sheath: 20/15 2X2,5insulation(R/B):35/35 sheath(R/B):40/40	P ☒ F ☐ N/A ☐ N/T ☐
	Permanent elongation after cooling max. 25%: [%]	1X240mm2: insulation/sheath: 0/0 2X2,5insulation(R/B):0/0 sheath(R/B):0/0	P ☒ F ☐ N/A ☐ N/T ☐
1.4	THERMAL ENDURANCE TEST ACCORDING TO EN 60216 PARTS 1 AND 2		
	The determined Arrhenius curve resulting from the test results of test according to IEC 60216-2 shows a thermal endurance of min. 20.000h at a temperature of 120°C. SEE ENCLOSURED ARRHENIUS-CALCULATION SHEET	Test data refer to test report 50289453 001	P ☒ F ☐ N/A ☐ N/T ☐
1.5	COLD ELONGATION TEST ACCORDING TO EN 60811-505		
1.5.1	Test conditions see EN 60811-505		
1.5.2	Elongation of break min. 30%: [%]	1X240: 51%	P ☒ F ☐ N/A ☐ N/T ☐
1.6	SHEATH RESISTANCE AGAINST ACID AND ALKALINE SOLUTION ACCORDING TO EN 60811-404		

Prüfbericht-Nr.: CN230O10 001
Test Report No.:

Seite 15 von 23
Page 15 of 23

Absatz	EN 50618:2014	Messergebnisse - Bemerkungen	Bewertung
Clause	Anforderungen - Prüfungen / Requirements - Tests	Measuring results - Remarks	Evaluation
1.6.1	Acid: N-Oxal-acid Alkaline solution: N-sodium hydroxide solution Temperature 23 C° Duration 168 h		
1.6.2	max. Variation of tensile strength $\pm 30\%$ <i>SEE TABLE B.1</i>		P ☒ F ☐ N/A ☐ N/T ☐
1.6.3	Min. Elongation at break $> 100\%$ <i>SEE TABLE B.1</i>		P ☒ F ☐ N/A ☐ N/T ☐
1.7	COMPATIBILITY TEST ACCORDING TO EN 60811-401		
1.7.1	Test conditions: Temperature 135 $\pm$ 2°C Duration of treatment 168 h		
1.7.2	Variation of tensile strength insulation max. $\pm 30\%$ Variation of tensile strength sheath max. - 30% <i>SEE TABLE B.1</i>		P ☒ F ☐ N/A ☐ N/T ☐
1.7.3	Variation of elongation at break insulation max. $\pm 30\%$ Variation of elongation at break sheath max. - 30% <i>SEE TABLE B.1</i>		P ☒ F ☐ N/A ☐ N/T ☐

Prüfbericht-Nr.: CN230O10 001 <i>Test Report No.:</i>	Seite 16 von 23 <i>Page 16 of 23</i>
---	---

Absatz	EN 50618:2014	Messergebnisse - Bemerkungen	Bewertung
<i>Clause</i>	<i>Anforderungen - Prüfungen / Requirements - Tests</i>	<i>Measuring results - Remarks</i>	<i>Evaluation</i>

		blank page	
--	--	------------	--

ANLAGE zum Prüfbericht-Nr.: CN230O10 001
APPENDIX to Test Report No.:

Seite 17 von 23
Page 17 of 23

ZUSATZ-DOKUMENTATION
ADDITIONAL DOCUMENTATION

TABLES:

H1Z2Z2-K 1X240mm²

Table B.1 MECHANICAL CHARACTERISTICS								
Samples of insulation ☒ test plate ☐ sleeve probe							red	
Samples of sheath ☒ test plate ☐ sleeve probe							red	
INSULATION								
	Values of tensile strength [N/mm²]:					Median [N/mm²]	Variation [%]	
Before ageing	-	-	-	-	-	15,5	-	
After ageing in oven	-	-	-	-	-	-	+9	
After damp heat test	-	-	-	-	-	-	-	
After test of mutual influence	-	-	-	-	-	-	+4	
	Values of elongation at break [%]:					Median %	Variation %	
Before ageing	-	-	-	-	-	230	-	
After ageing in oven	-	-	-	-	-	-	-9	
After damp heat test	-	-	-	-	-	-	-	
After test of mutual influence	-	-	-	-	-	-	-4	
During cold elongation test	-	-	-	-	-	-	-	
SHEATH								
	Values of tensile strength [N/mm²]:					Median [N/mm²]	Variation [%]	
Before ageing	-	-	-	-	-	11,5	-	
After ageing in oven	-	-	-	-	-	-	+10	
After damp heat test	-	-	-	-	-	-	+3	
After storing in acid	-	-	-	-	-	-	-4	
After storing in alkaline	-	-	-	-	-	-	-4	
After storing UV Weathering	-	-	-	-	-	-	89	
After test of mutual influence	-	-	-	-	-		+5	
	Values of elongation at break [%]:					Median [%]	Variation [%]	
Before ageing	-	-	-	-	-	190	-	
After ageing in oven	-	-	-	-	-	-	-11	
After damp heat test	-	-	-	-	-	-	-5	
After storing in acid	-	-	-	-	-	170	-	
After storing in alkaline	-	-	-	-	-	175	-	
After storing UV Weathering	-	-	-	-	-	-	84	
After test of mutual influence	-	-	-	-	-	-	-8	
During cold elongation test	-	-	-	-	-	-	51	

ANLAGE zum Prüfbericht-Nr.: CN230O10 001
APPENDIX to Test Report No.:

Seite 18 von 23
Page 18 of 23

ZUSATZ-DOKUMENTATION
ADDITIONAL DOCUMENTATION

H1Z2Z2-K 2X2,5mm²(R)

Table B.1 MECHANICAL CHARACTERISTICS							
Samples of insulation ☐ test plate ☒ sleeve probe						red	
Samples of sheath ☐ test plate ☒ sleeve probe						black	
INSULATION							
	Values of tensile strength [N/mm²]:					Median [N/mm²]	Variation [%]
Before ageing	-	-	-	-	-	16,0	-
After ageing in oven	-	-	-	-	-	-	-5
After damp heat test	-	-	-	-	-	-	-
After test of mutual influence	-	-	-	-	-	-	-1
	Values of elongation at break [%]:					Median %	Variation %
Before ageing	-	-	-	-	-	210	-
After ageing in oven	-	-	-	-	-	-	-5
After damp heat test	-	-	-	-	-	-	-
After test of mutual influence	-	-	-	-	-	-	+5
During cold elongation test	-	-	-	-	-	-	-
SHEATH							
	Values of tensile strength [N/mm²]:					Median [N/mm²]	Variation [%]
Before ageing	-	-	-	-	-	13,3	-
After ageing in oven	-	-	-	-	-	-	+4
After damp heat test	-	-	-	-	-	-	-2
After storing in acid	-	-	-	-	-	-	+3
After storing in alkaline	-	-	-	-	-	-	+5
After storing UV Weathering	-	-	-	-	-	-	88
After test of mutual influence	-	-	-	-	-	-	+2
	Values of elongation at break [%]:					Median [%]	Variation [%]
Before ageing	-	-	-	-	-	150	-
After ageing in oven	-	-	-	-	-	-	-7
After damp heat test	-	-	-	-	-	-	-7
After storing in acid	-	-	-	-	-	140	-
After storing in alkaline	-	-	-	-	-	140	-
After storing UV Weathering	-	-	-	-	-	-	93
After test of mutual influence	-	-	-	-	-	-	0
During cold elongation test	-	-	-	-	-	-	-

ANLAGE zum Prüfbericht-Nr.: CN230O10 001
APPENDIX to Test Report No.:

Seite 19 von 23
Page 19 of 23

ZUSATZ-DOKUMENTATION
ADDITIONAL DOCUMENTATION

H1Z2Z2-K 2X2,5mm²(B)

Table B.1 MECHANICAL CHARACTERISTICS							
Samples of insulation ☐ test plate ☒ sleeve probe						black	
Samples of sheath ☐ test plate ☒ sleeve probe						black	
INSULATION							
	Values of tensile strength [N/mm²]:					Median [N/mm²]	Variation [%]
Before ageing	-	-	-	-	-	16,0	-
After ageing in oven	-	-	-	-	-	-	-3
After damp heat test	-	-	-	-	-	-	-
After test of mutual influence	-	-	-	-	-	-	-1
	Values of elongation at break [%]:					Median %	Variation %
Before ageing	-	-	-	-	-	225	-
After ageing in oven	-	-	-	-	-	-	-9
After damp heat test	-	-	-	-	-	-	-
After test of mutual influence	-	-	-	-	-	-	0
During cold elongation test	-	-	-	-	-	-	-
SHEATH							
	Values of tensile strength [N/mm²]:					Median [N/mm²]	Variation [%]
Before ageing	-	-	-	-	-	14,0	-
After ageing in oven	-	-	-	-	-	-	+4
After damp heat test	-	-	-	-	-	-	-4
After storing in acid	-	-	-	-	-	-	+2
After storing in alkaline	-	-	-	-	-	-	+3
After storing UV Weathering	-	-	-	-	-	-	86
After test of mutual influence	-	-	-	-	-	-	+2
	Values of elongation at break [%]:					Median [%]	Variation [%]
Before ageing	-	-	-	-	-	150	
After ageing in oven	-	-	-	-	-	-	+7
After damp heat test	-	-	-	-	-	-	-7
After storing in acid	-	-	-	-	-	140	-
After storing in alkaline	-	-	-	-	-	140	-
After storing UV Weathering	-	-	-	-	-	-	93
After test of mutual influence	-	-	-	-	-	-	0
During cold elongation test	-	-	-	-	-	-	-

ZUSATZ-DOKUMENTATION
ADDITIONAL DOCUMENTATION

Table 5.1.5 COMPLIANCE OF CONDUCTOR WITH CLASS 5 OF IEC 60228

	Diameter of single wires		Resistance of conductor	
	Max. [mm]	Measured [mm]	Max. [Ω /km]	Measured [Ω/km]
H1Z2Z2-K 1X240mm ²	0,51	0,39	0,0817	0,0780
H1Z2Z2-K 2X2,5mm ² (R)	0,26	0,24	8,21	7,49
H1Z2Z2-K 2X2,5mm ² (B)	0,26	0,24	8,21	7,52
H1Z2Z2-K 2X10mm ² (R)	0,41	0,39	-	-
H1Z2Z2-K 2X10mm ² (B)	0,41	0,39	-	-

Table 8.1 INSULATION RESISTANCE VALUE

Cross section mm ²	Insulation resistance at 20°C		Insulation resistance at 90°C	
	Min. MΩ /km	Measured MΩ /km	Min. MΩ /km	Measured MΩ /km
1X240	200	1040	0,20	4,80
2X2,5(R)	862	2130	0,862	8,10
2X2,5(B)	862	2100	0,862	7,90

Table 5.2.3 WALL THICKNESS OF INSULATION

Values of measured wall thickness not less than stated in clause 5.2.3 of this standard (smallest value shall be highlighted) [mm]							Average value [mm]	Minimum thickness of insulation [mm]	Smallest measured value not less than $t_m \geq 0,9t_s - 0,1$ mm
1X240mm ²	-	-	-	-	-	-	1,7	1,59	1,43
2X2,5mm ² (R)	-	-	-	-	-	-	0,9	0,73	0,53
2X2,5mm ² (B)	-	-	-	-	-	-	0,9	0,71	0,53
2X10mm ² (R)	-	-	-	-	-	-	0,8	0,57	0,53
2X10mm ² (B)	-	-	-	-	-	-	0,9	0,68	0,53

Table 5.3.3 WALL THICKNESS OF SHEATH

Values of measured wall thickness not less than stated in clause 5.3.3 of this standard (smallest value shall be highlighted) [mm]							Average value [mm]	Minimum thickness of sheath [mm]	Smallest measured value not less than $t_m \geq 0,85t_s - 0,1$ mm
1X240mm ²	-	-	-	-	-	-	2,0	1,93	1,35
2X2,5mm ² (R)	-	-	-	-	-	-	0,9	0,84	0,58
2X2,5mm ² (B)	-	-	-	-	-	-	0,9	0,83	0,58

ANLAGE zum Prüfbericht-Nr.: CN230O10 001
APPENDIX to Test Report No.:

Seite 21 von 23
Page 21 of 23

ZUSATZ-DOKUMENTATION
ADDITIONAL DOCUMENTATION

2X10mm ² (R)	-	-	-	-	-	-	1,2	0,91	0,58
2X10mm ² (B)	-	-	-	-	-	-	1,0	0,89	0,58

Table 7.3.3 MEAN VALUES AND OVALITY OF CABLE

Values of measured ovality not less than stated in clause 7.3.3 of this standard

	Sample 1		Sample 2		Sample 3		Average value [mm]	Manufacturer spec. [mm]	Ovality [%]
	Value 1 [mm]	Value 2 [mm]	Value 1 [mm]	Value 2 [mm]	Value 1 [mm]	Value 2 [mm]			
1X240 mm ²	-	-	-	-	-	-	29,3	-	2
2X2,5mm ² (R)	-	-	-	-	-	-	5,6	-	2
2X2,5mm ² (B)	-	-	-	-	-	-	5,6	-	3
2X10mm ² (R)	-	-	-	-	-	-	8,0	-	2
2X10mm ² (B)	-	-	-	-	-	-	7,8	-	2

Table 7.4 Dynamic penetration test (Annex D)

Nominal cross-sectional area of conductor: [mm ²]	240	2X2,5(R)	2X2,5(B)		
Rated diameter of conductor according to table 1 or table 2 of IEC 60719 (D _n): [mm]	20,1	1,95	1,95		
Minimum value of force (150 * √D _n): [N]	672	209	209		
Determined mean value of force: [N]	964	358	350		

1.4 Thermal endurance properties

Testing method according to EN 60216-2

Test conditions

Temperature Index : 120

Selected exposure : 185°C, 165°C, 145°C

Elongation at break : 50 %

ZUSATZ-DOKUMENTATION
ADDITIONAL DOCUMENTATION

Test sample	Time to end-point at exposure temperature 185°C hour	Specified time (min.) h	Time to end-point at exposure temperature 165°C hour	Time to end-point at exposure temperature 145°C hour	Specified time (min.) h	Obtained absolute temperature K	Absolute temperature (min.) K	
insulation	276	100	2811	5274	5000	396	393	P
sheath	242	100	2818	6387	5000	401	393	P

Thermal endurance graph for insulation material

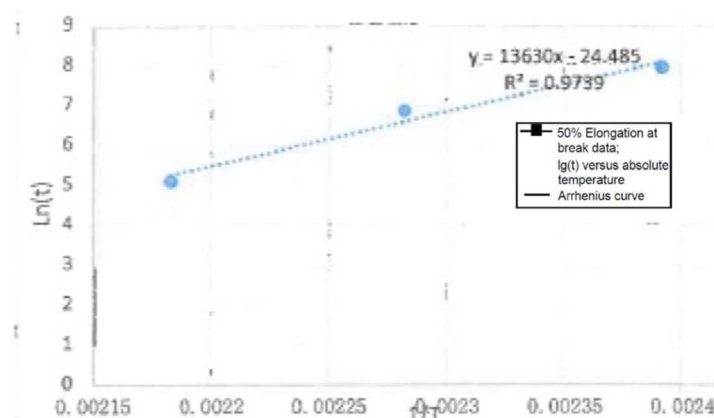


Figure1 The Arrhenius curve of the insulation

Remark: The value of t is equal to 20000h at $\lg(t)=4,30$.

Thermal endurance graph for sheath material

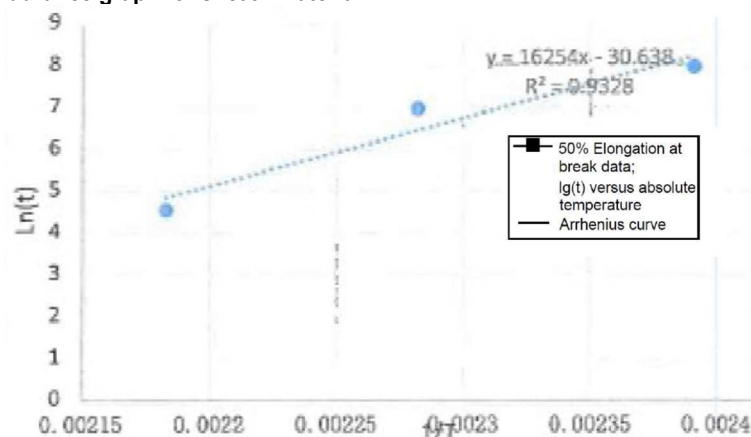


Figure2 The Arrhenius curve of the Sheath

Remark: The value of t is equal to 20000h at $\lg(t)=4,30$.

ANLAGE zum Prüfbericht-Nr.: CN230O10 001
APPENDIX to Test Report No.:

Seite 23 von 23
Page 23 of 23

ZUSATZ-DOKUMENTATION
ADDITIONAL DOCUMENTATION

Test for separation of cores:

CONNECTION PART FOR 2X2,5mm ²			
Width(mm)	Thickness(mm)	Strip force(N)	Surface check
0,5	0,6	13	No cracks

CONNECTION PART FOR 2X10mm ²			
Width(mm)	Thickness(mm)	Strip force(N)	Surface check
1,0	0,9	22	No cracks

End of the report

List of test equipment used-IEC 62930
(GL202304094、GL202304097、GL202304100)

Clause	Measurement / testing	Testing / measuring equipment / material used, (Equipment ID)	Range used	Last Calibration date	Calibration due date
	Measurement of thickness of insulation	MCDMS Automatic Measuring System of Wire and Cable Structural Parameters (16-1334)	1~130mm	2023.02.17	2024.02.16
	Measurement of thickness of sheath	MCDMS Automatic Measuring System of Wire and Cable Structural Parameters (16-1334)	1~130mm	2023.02.17	2024.02.16
	Measurement of thickness of overall dimensions	MCDMS Automatic Measuring System of Wire and Cable Structural Parameters (16-1334)	1~130mm	2023.02.17	2024.02.16
	Measurement of dimensions for joint	FKT Measuring Projector (03-2114)	10 times,	2023.02.17	2024.02.16
	Hot set test	RYS-III Hot Set Tester (03-2216)	RT+10~300℃	2023.01.06	2024.01.05
	Hot set test	Electronic Balance (17-0132-7)	0~220g	2023.11.10	2024.11.09
	Hot set test	Electronic Balance (17-0131-7)	0~220g	2023.11.10	2024.11.09
	Hot set test	Dial gauge (D23-0036)	0~10mm	2023.08.18	2024.08.17
	Hot set test	Vernier caliper (D03-0055)	0~150mm	2023.10.07	2024.10.06
	Hot set test	Stopwatch (03-2375)	-	2023.09.26	2024.09.25
	Shrinkage test at complete cable	RYS-III Hot Set Tester (03-2217)	RT+10~300℃	2023.01.06	2024.01.05
	Shrinkage test at complete cable	Steel ruler (D03-0043)	0~300mm	2023.10.07	2024.10.06
	Shrinkage test at complete cable	Steel ruler (D03-0041)	0~300mm	2023.10.07	2024.10.06
	Dynamic penetration test	Dynamic penetration Tester (03-2393)	0~1000N	2023.02.17	2024.02.16
	Dynamic penetration test	Steel ruler (D03-0043)	0~300mm	2023.10.07	2024.10.06



	Dynamic penetration test	Steel tape measure (03-2109)	0~5m	2023.07.21	2024.01.20
	Cold Impact test at -40℃	DWCJ Impact Testing Machine (03-2210)	100g~1500g	2023.02.17	2024.02.16
	Cold Impact test at -40℃	Low Temperature Test Chamber (03-2220)	-40℃~150℃	2023.01.06	2024.01.05
	Cold Impact test at -40℃	Vernier caliper (D03-0055)	0~150mm	2023.10.07	2024.10.06
	Cold bending test at -40℃	DWJR Low temperature automatic winding instrument (03-2209)	0~12.5mm	2023.02.17	2024.02.16
	Cold bending test at -40℃	Low Temperature Test Chamber (03-2222)	-70℃~100℃	2023.01.06	2024.01.05
	Cold bending test at -40℃	Vernier caliper (D03-0055)	0~150mm	2023.10.07	2024.10.06
	Cold elongation test at -40℃	DLY/A Tensile Testing Machine (03-2098)	0~200mm	2023.02.17	2024.02.16
	Cold elongation test at -40℃	Low Temperature Test Chamber (03-2221)	-70℃~100℃	2023.01.06	2024.01.05
	Cold elongation test at -40℃	Vernier caliper (D03-0055)	0~150mm	2023.10.07	2024.10.06
	Resistance of conductors	PC36C DC Resistance Tester (03-2186)	0,01μΩ-199,99Ω	2023.02.28	2024.02.27
	Resistance of conductors	Conductor resistance Clamp (03-2390-1)	0~1000mm	2023.02.17	2024.02.16
	Resistance of conductors	Digital thermohygrograph (D03-0048)	-40℃~85℃ 0%~100%RH	2023.10.07	2024.10.06
	Voltage test on completed cable with AC or DC	JTGN-10kVA/25kV AC Voltage Test System (03-2123)	0~25kV	2023.02.14	2024.02.13
	Voltage test on completed cable with AC or DC	SY-3 Constant Temperature Water Bath Apparatus (03-2213)	RT+5℃ ~99.9℃	2023.01.06	2024.01.05
	Voltage test on completed cable with AC or DC	Tape measure (D03-0018)	0~10m	2023.07.21	2024.01.20
	Surface resistance of sheath	Damp heat Chamber (03-2076)	0℃~150℃ 25~98%RH	2023.01.06	2024.01.05
	Surface resistance of sheath	ZC-90G Insulated Resistance Tester (03-2190)	100~2×10 ¹⁷ Ω	2023.10.08	2024.10.07

	Surface resistance of sheath	Steel tape measure (D03-0018)	0~5m	2023.07.21	2024.01.20
	Surface resistance of sheath	Vernier caliper (D03-0056)	0~150mm	2023.10.07	2024.10.06
	Long term resistance of insulation to D.C.	Constant Temperature Water Bath Apparatus (16-1261)	RT~98℃	2023.01.06	2024.01.05
	Long term resistance of insulation to D.C	Voltage Test System (22-0043)	0~10kV	2023.10.30	2024.10.29
	Long term resistance of insulation to D.C	High voltage digital display power (03-2061)	0~3000V	2023.10.25	2024.10.24
	Long term resistance of insulation to D.C	Steel tape measure (D03-0018)	0~5m	2023.07.21	2024.01.20
	Insulation resistance	ZC-90G Insulated Resistance Tester (03-2190)	100~2×10 ¹⁷ Ω	2023.10.08	2024.10.07
	Insulation resistance	SYT-3 Constant Temperature Water Bath Apparatus (03-2213)	RT+5℃ ~99.9℃	2023.01.06	2024.01.05
	Insulation resistance	SYT-III Constant Temperature Water Bath Apparatus (03-2059)	RT+5℃ ~95.0℃	2023.01.06	2024.01.05
	Insulation resistance	Steel tape measure (D03-0018)	0~5m	2023.07.21	2024.01.20
	Test for vertical flame propagation at complete cable	JS/DR-III Single Cables Vertical Flammability Tester (03-2384)	-	2023.01.06	2024.01.05
	Test for vertical flame propagation at complete cable	Vernier caliper (D17-0184)	0~150mm	2023.01.31	2024.01.30
	Test for vertical flame propagation at complete cable	Steel tape measure (D22-0011)	0~10m	2023.09.04	2024.03.03
	Ozone resistance test at complete cable	Ozone Ageing Testing Chamber (03-2130)	100-300ppm	2023.01.06	2024.01.05
	Ozone resistance test at complete cable	Vernier caliper (D17-0184)	0~150mm	2023.01.31	2024.01.30

	Assessment of halogen	Acid Gas Emission Tester (03-2169)	Ambient temperature ~950℃	2023.01.06	2024.01.05
	Assessment of halogen	pH (03-2169-3)	0.00-14.00	2023.10.19	2024.10.18
	Assessment of halogen	Conductivity Tester (03-2169-4)	0.00 μ S/cm~100.0 mS/cm	2023.10.19	2024.10.18
	Assessment of halogen	Electronic Balance (03-2225)	0~210g	2023.11.10	2024.11.09
	Assessment of halogen	Fluorine Content Tester (03-2180)	0.001~9999 ppm	2023.10.19	2024.10.18
	Smoke density	Smoke density tester (03-2183)	0~100%	2023.02.17	2024.02.16
	Smoke density	MCDMS Automatic Measuring System of Wire and Cable Structural Parameters (16-1334)	1~130mm	2023.02.17	2024.02.16
	Smoke density	Vernier caliper (D17-0184)	0~150mm	2023.01.31	2024.01.30
	Mechanical properties before ageing	CMT6502 Microcomputer Control Electronic Universal Testing Machine (03-2241)	0~500N	2023.02.14	2024.02.13
	Mechanical properties before ageing	CMT6502 Microcomputer Control Electronic Universal Testing Machine (03-2242)	0~500N	2023.02.14	2024.02.13
	Mechanical properties before ageing	Vernier caliper (D19-0045)	0~150mm	2023.01.31	2024.01.30
	Mechanical properties before ageing	Dial gauge (D23-0035)	0~10mm	2023.08.18	2024.08.17
	Mechanical properties after ageing	CMT6502 Microcomputer Control Electronic Universal Testing Machine (03-2241)	0~500N	2023.02.14	2024.02.13
	Mechanical properties after ageing	CMT6502 Microcomputer Control Electronic Universal Testing Machine (03-2242)	0~500N	2023.02.14	2024.02.13
	Mechanical properties after ageing	Vernier caliper (D19-0045)	0~150mm	2023.01.31	2024.01.30
	Mechanical properties after ageing	Dial gauge (D23-0035)	0~10mm	2023.08.18	2024.08.17

	Mechanical properties after ageing	LHX- II Air Oven (03-2149)	Ambient temperature ~300℃	2023.01.06	2024.01.05
	Test of mutual influence	CMT6502 Microcomputer Control Electronic Universal Testing Machine (03-2241)	0~500N	2023.02.14	2024.02.13
	Test of mutual influence	CMT6502 Microcomputer Control Electronic Universal Testing Machine (03-2242)	0~500N	2023.02.14	2024.02.13
	Test of mutual influence	RL100 Air Oven (03-2154)	Ambient temperature ~300℃	2023.01.06	2024.01.05
	Test of mutual influence	RL100 Air Oven (03-2176)	Ambient temperature ~300℃	2023.01.06	2024.01.05
	Test of mutual influence	Vernier caliper (D19-0045)	0~150mm	2023.01.31	2024.01.30
	Test of mutual influence	Dial gauge (D23-0035)	0~10mm	2023.08.18	2024.08.17
	Damp heat test	Damp heat Chamber (03-2250)	-40℃~150℃ 25~98%RH	2023.01.06	2024.01.05
	Damp heat test	CMT6502 Microcomputer Control Electronic Universal Testing Machine (03-2242)	0~500N	2023.02.14	2024.02.13
	Damp heat test	CMT6502 Microcomputer Control Electronic Universal Testing Machine (03-2241)	0~500N	2023.02.14	2024.02.13
	Damp heat test	Vernier caliper (D19-0045)	0~150mm	2023.01.31	2024.01.30
	Damp heat test	Dial gauge (D23-0035)	0~10mm	2023.08.18	2024.08.17
	Resistance against acid and alkaline solution	CMT6502 Microcomputer Control Electronic Universal Testing Machine (03-2241)	0~500N	2023.02.14	2024.02.13
	Resistance against acid and alkaline solution	CMT6502 Microcomputer Control Electronic Universal Testing Machine (03-2242)	0~500N	2023.02.14	2024.02.13

	Resistance against acid and alkaline solution	Vernier caliper (D19-0045)	0~150mm	2023.01.31	2024.01.30
	Resistance against acid and alkaline solution	Dial gauge (D23-0035)	0~10mm	2023.08.18	2024.08.17
	Weathering/UV-resistance	CMT6502 Microcomputer Control Electronic Universal Testing Machine (03-2241)	0~500N	2023.02.14	2024.02.13
	Weathering/UV-resistance	CMT6502 Microcomputer Control Electronic Universal Testing Machine (03-2242)	0~500N	2023.02.14	2024.02.13
	Weathering/UV-resistance	CI4000 Xenon Weather-Ometer (16-1324)	RT~100℃	2022.12.22	2023.12.21
	Weathering/UV-resistance	Vernier caliper (D19-0045)	0~150mm	2023.01.31	2024.01.30
	Weathering/UV-resistance	Dial gauge (D23-0035)	0~10mm	2023.08.18	2024.08.17
	Marking	Steel tape measure (03-2109)	0~5m	2023.07.21	2024.01.20
	Test for separation	CMT6502 Microcomputer Control Electronic Universal Testing Machine (03-2241)	0~500N	2023.02.14	2024.02.13

